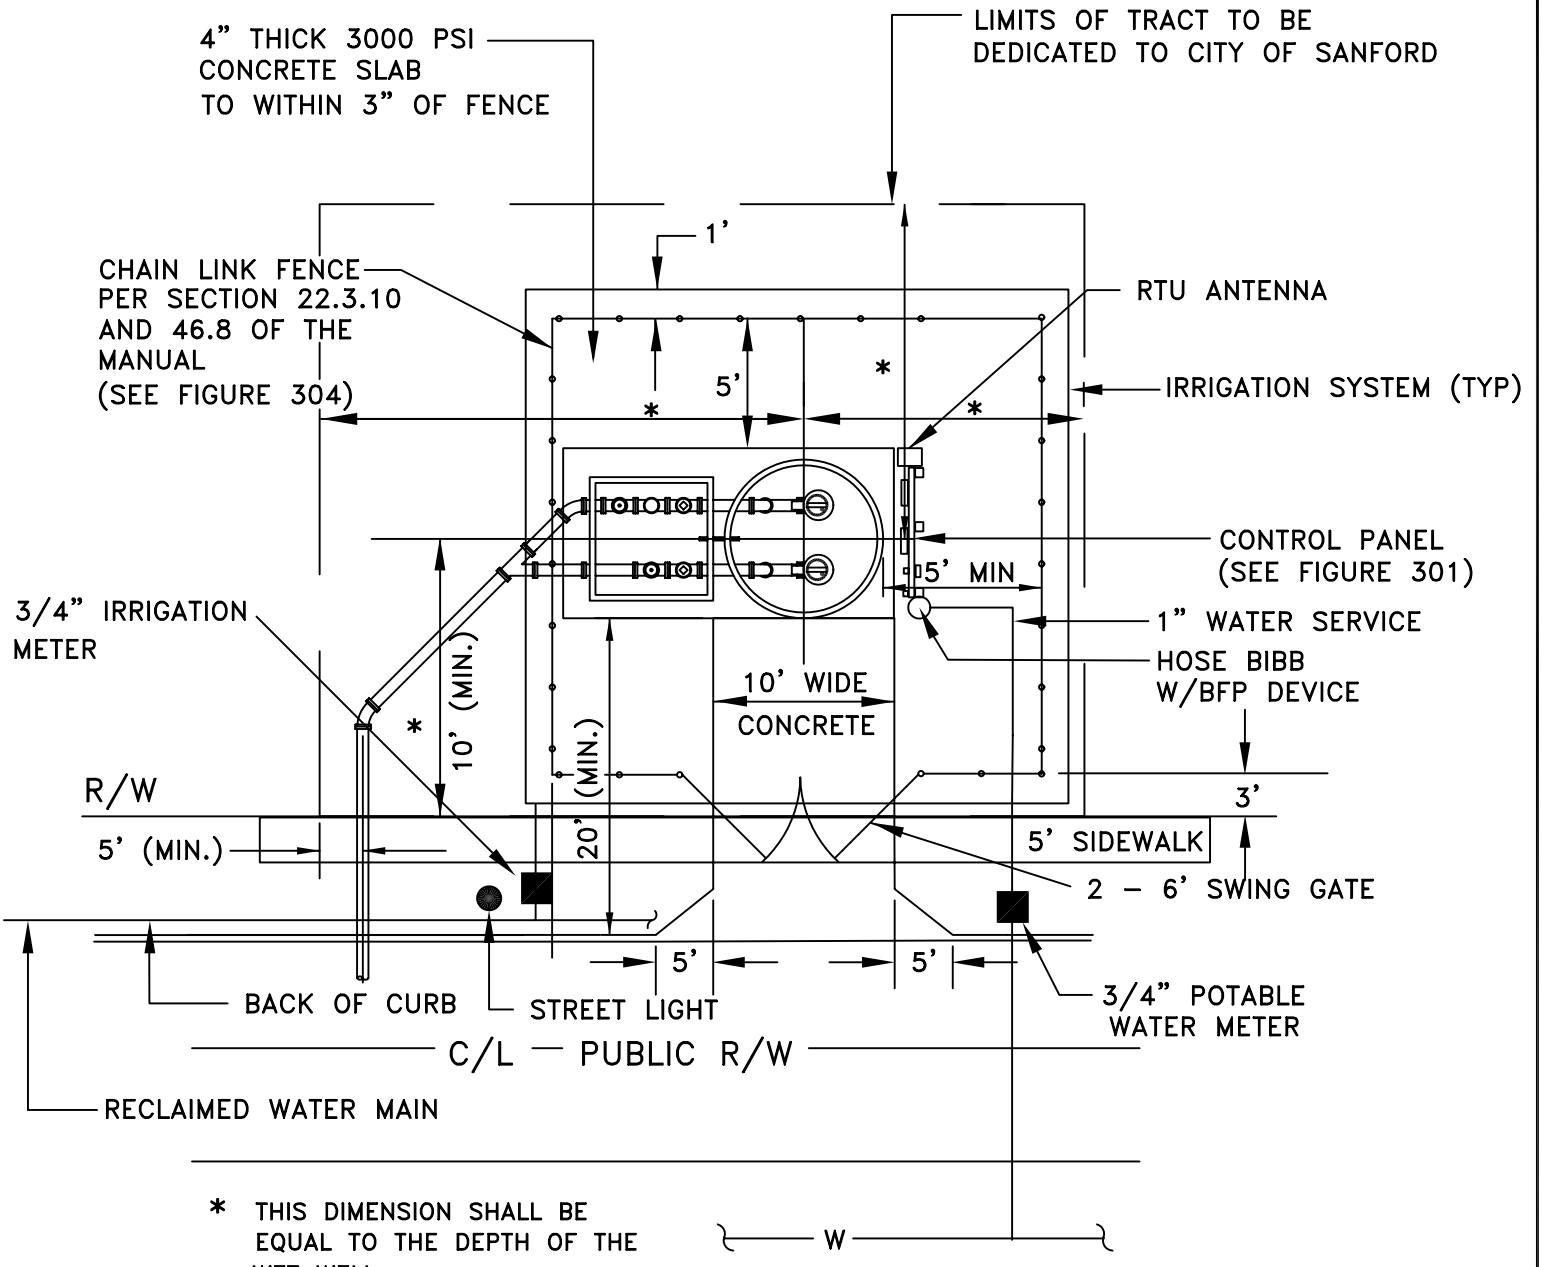

* THIS DIMENSION SHALL BE EQUAL TO THE DEPTH OF THE WET WELL.

NOTES:

DETAIL

1. DRIVEWAY AND APRON SHALL BE SIX (6) INCH THICK, 3000 P.S.I. CONCRETE.
2. POWER TO THE PUMP STATION SHALL BE THROUGH UNDERGROUND CONDUIT FROM SUPPLY SOURCE IN RIGHT OF WAY.
3. LANDSCAPING SHALL BE REQUIRED AROUND PERIMETER OF FENCE.
4. DEVELOPER SHALL INSTALL AN AUTOMATICALLY CONTROLLED AC POWERED SPRINKLER SYSTEM FOR LANDSCAPING. RECLAIMED WATER SHALL BE USED WHERE AVAILABLE
5. ENGINEER SHALL PROVIDE A SCALED (1" = 20' MIN.) SITE SPECIFIC DETAIL DRAWING ON FIGURE 302.
6. THE DEVELOPER SHALL BE RESPONSIBLE FOR ALL UTILITY ACCOUNTS DURING CONSTRUCTION UNTIL PROJECT IS ACCEPTED BY THE CITY.

PUMP STATION TYPICAL SITE PLAN