


NOTES

1. THIS DETAIL IS DIAGRAMMATIC ONLY. ARRANGE PIPING TO PROVIDE READY ACCESS TO ALL COMPONENTS. ALL ITEMS SHALL BE RIGIDLY SUPPORTED.
2. DIMENSIONS WILL VARY ACCORDING TO LINE SIZE. MINIMUM SIZE OF BOX SHALL BE 48 INCHES BY 48 INCHES WITH A 24 INCH BY 36 INCH MINIMUM STRUCTURAL ALUMINUM ACCESS HATCH COVER. ALL HARDWARE AND LOCK BRACKETS SHALL BE 304 STAINLESS STEEL.
3. PRESSURE SWITCH SHALL BE ADJUSTABLE WITH THE INITIAL SETTING TO CUT OFF PUMP STATION AT A FORCE MAIN PRESSURE OF 20 P.S.I. THE ON AND OFF PUMP DIFFERENTIAL SHALL BE 10 P.S.I. AND ADJUSTABLE.

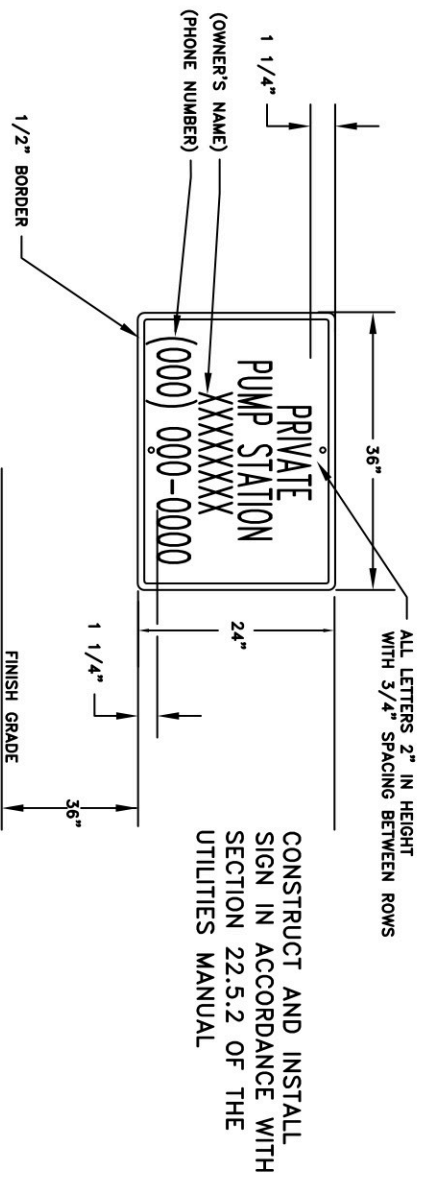

PRIVATE PUMP STATION PRESSURE SWITCH AND SIGNAGE DETAILS